
SMA Flexible Storage System

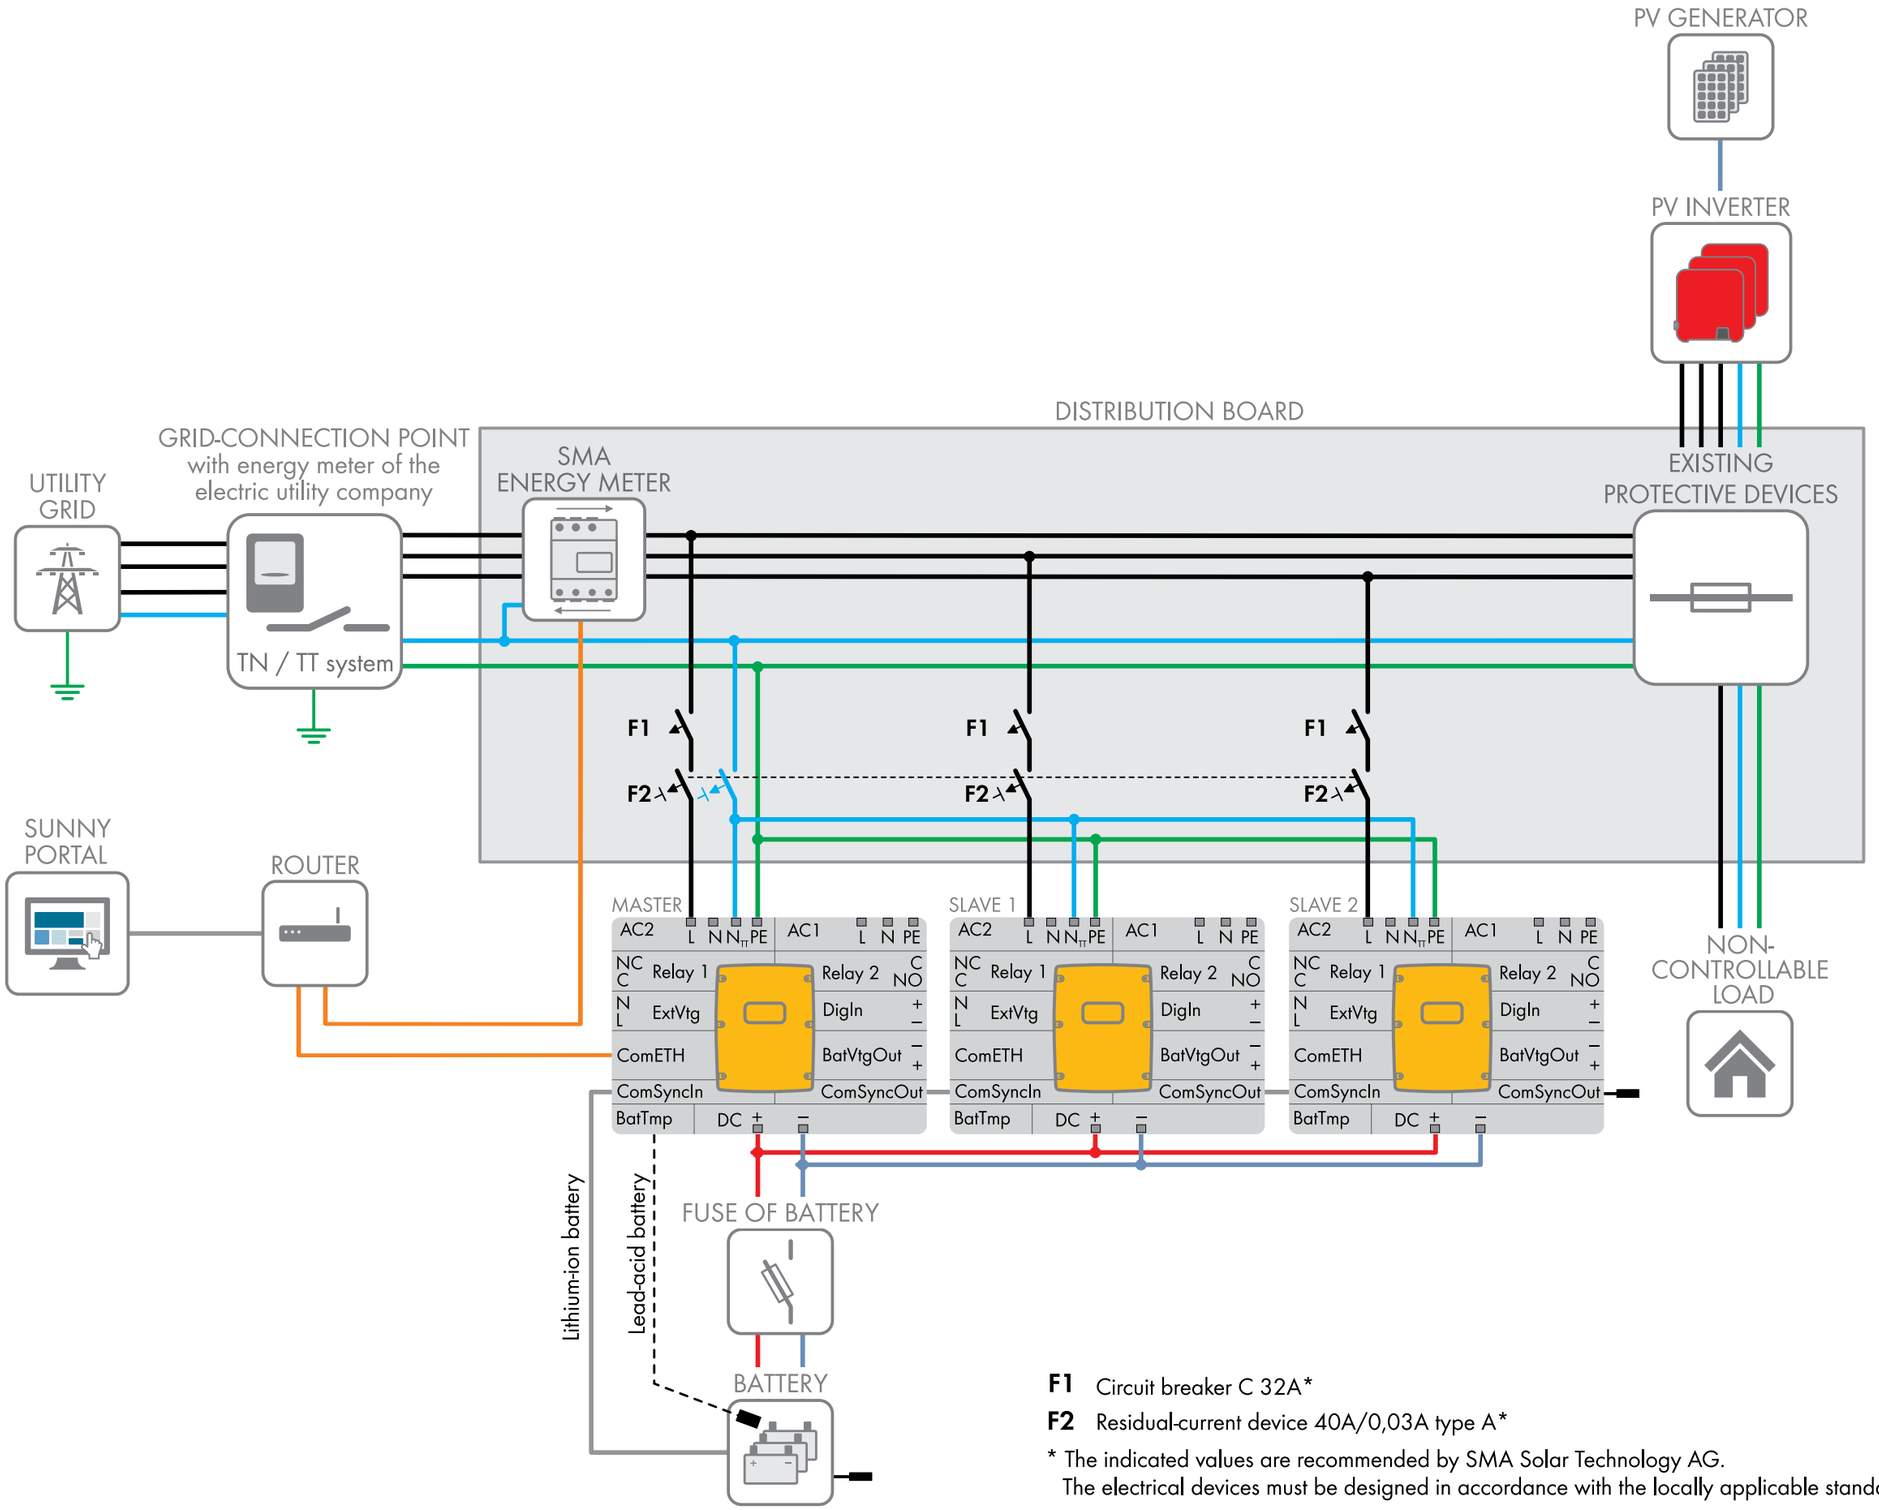

F1 Circuit breaker C 32A*

F2 Residual-current device 40A/0,03A type A*

* The indicated values are recommended by SMA Solar Technology AG.
The electrical devices must be designed in accordance with the locally applicable standards and directives.

SI44M-80H-13-FSS-IAU-xx-10